


SANITARY SEWER CROSSING OVER WATER MAIN

NO SCALE

JOINT ENCASEMENT AS PER
STANDARD PLAN I33
*IF VERT. CLEARANCE IS
LESS THAN 18"

ONE FULL LENGTH OF SANITARY SEWER PIPE SHALL BE
INSTALLED CENTERED ON WATER MAIN CROSSING SO THAT
JOINTS ARE AS FAR AS POSSIBLE FROM WATER MAIN
FOR VERTICAL CLEARANCES OF 6"-18"

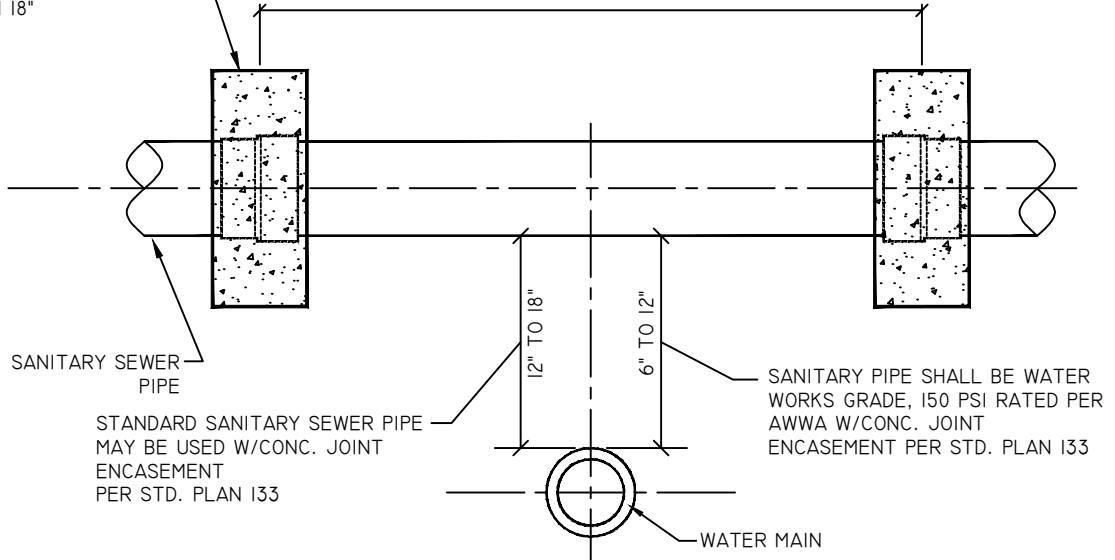


NOTE:
VERTICAL CLEARANCES UNDER
18" SHALL REQUIRE APPROVAL
FROM THE UTILITIES DEPT.

NOTE:
WHEN MORE THAN 18" OF VERT.
CLEARANCE EXISTS, STANDARD
SANITARY SEWER PIPE MAY BE
USED THROUGHOUT.

SANITARY SEWER CROSSING UNDER WATER MAIN

NO SCALE

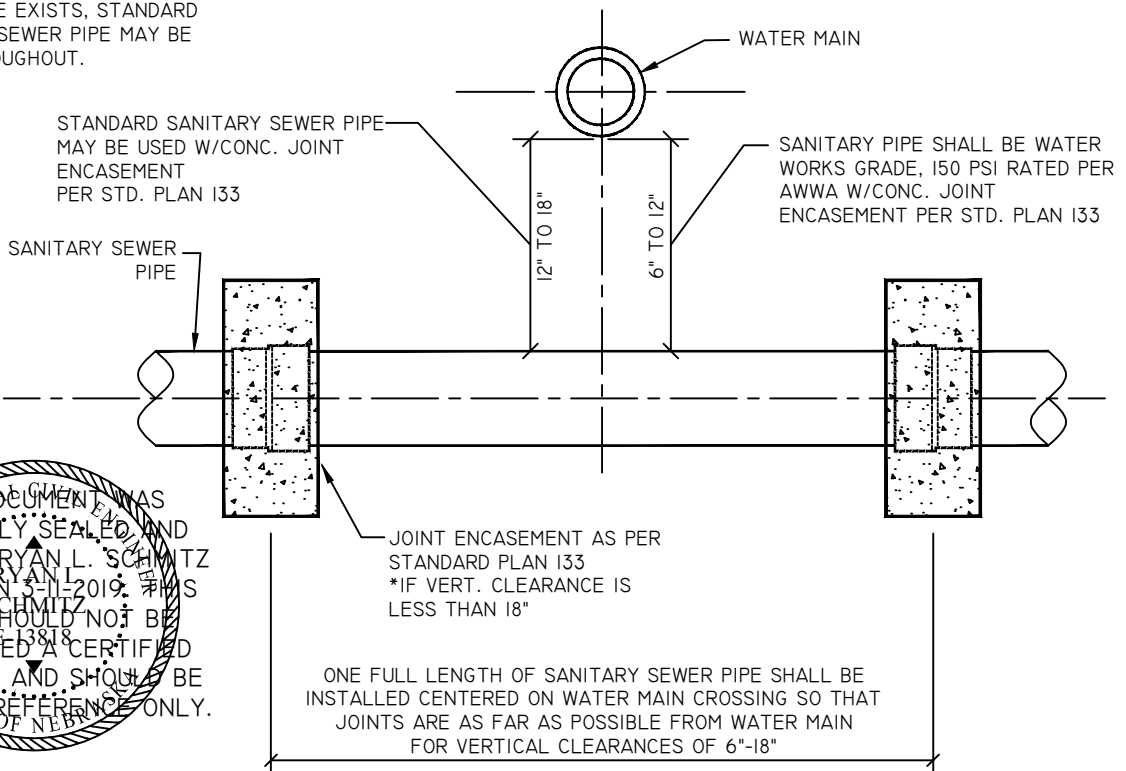

THIS DOCUMENT WAS
 ORIGINALLY SEALED AND
 ISSUED BY RYAN L. SCHMITZ
 E-13818, ON 3-11-2019. THIS
 MEDIA SHOULD NOT BE
 CONSIDERED A CERTIFIED
 DOCUMENT, AND SHOULD BE
 USED FOR REFERENCE ONLY.
 OF NEB.